

ATTACHMENT-5



TANKS 1-2

CUSTOMER APPROVAL☐ APPROVED FOR PRODUCTION AS DRAWN.☐ REVISE AS NOTED & RESUBMIT FOR APPROVAL.

SIGNATURE: _____

DATE: _____

DRAWING IS NOT VALID UNLESS SIGNED

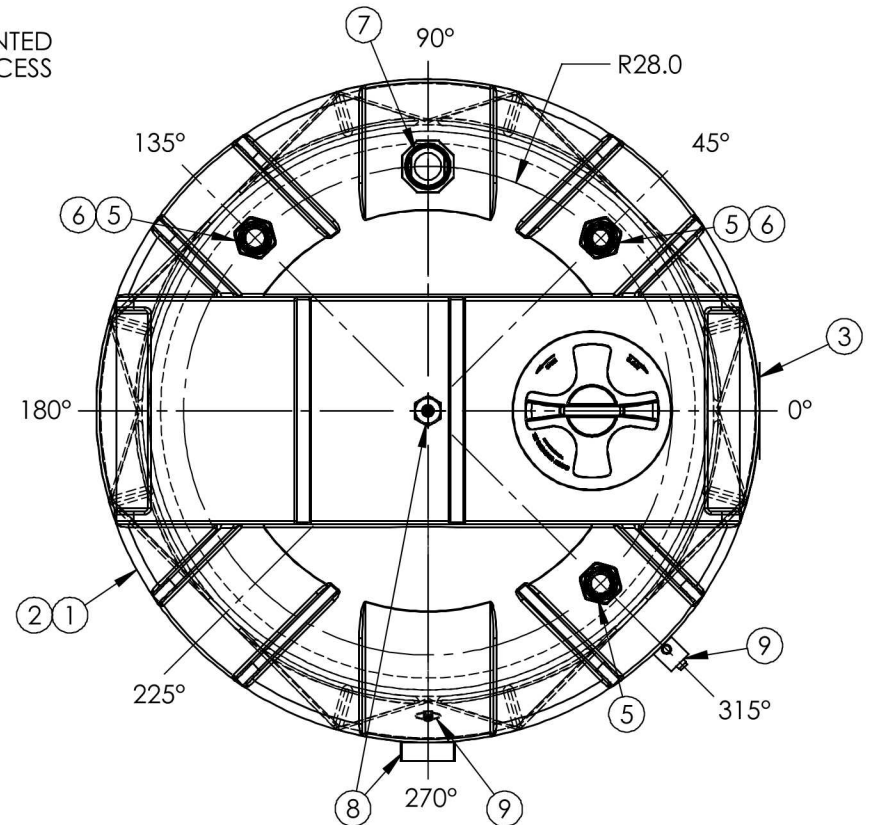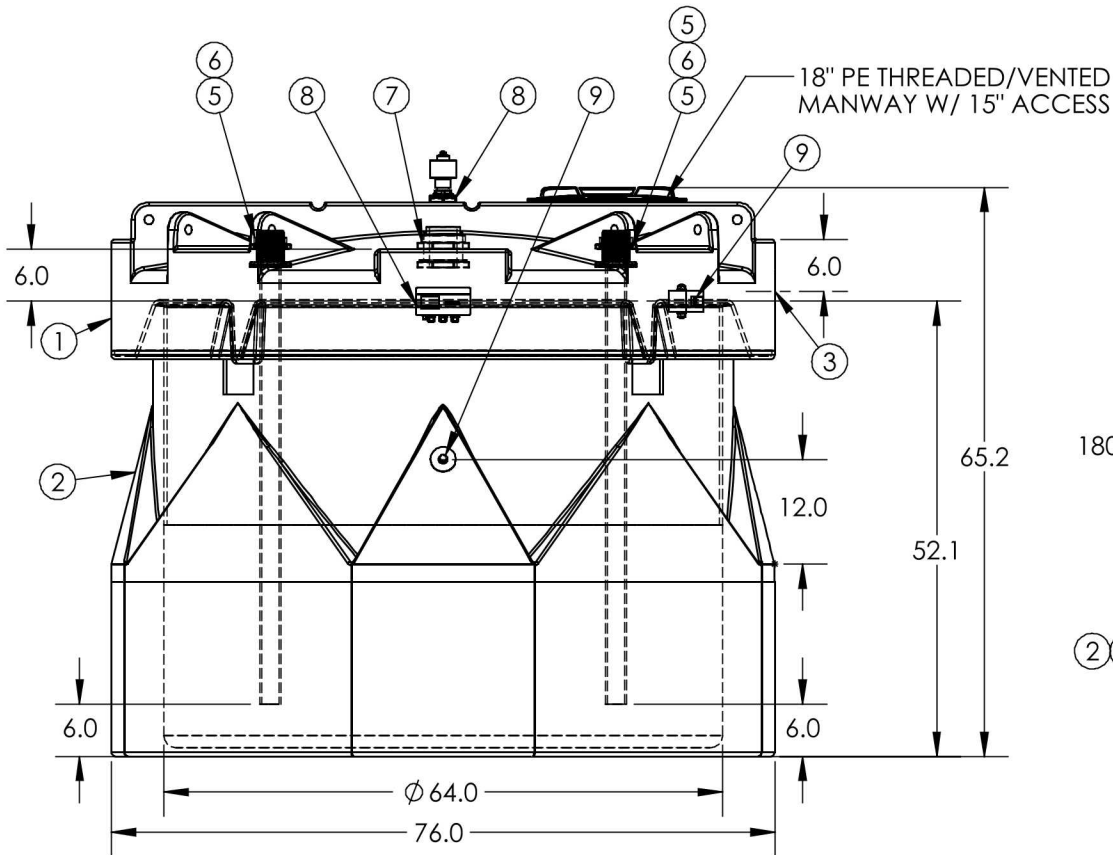

9	1	34701030	ASM LEAK DETECTION SYS 275-10000 DCT/CCS	YES	YES
8	1	34702356	ASM DST5111 ULTRASONIC LEVEL SENSOR 2IN	YES	YES
7	1	34700754	ASM FTG CPVC 3IN BH SXT VITON	YES	YES
6	10FT	34400157	PIPE CPVC 2IN SCH 80	YES	YES
5	3	34700753	ASM FTG CPVC 2IN BH SXT VITON	YES	YES
4	1	00000171	PROTECTIVE PLASTIC PACKAGING 200 - 850	NO	YES
3	1	35600482	DECAL MALTZ SALES COMPANY	YES	YES
2	1	5030000N97201	ASM TK 550CC X 76 HD/NAT 1.9	YES	YES
1	1	5040000N98701	ASM TK 550CP X 54 HD/NAT 1.9 SULF	YES	YES
ITEM NO.	QTY.	PART NUMBER	DESCRIPTION	SHOWN	TANK CONFIG.

CUSTOMER:

MALTZ

CUSTOMER NO:

MM40311

DO NOT SCALE		DRAWN BY			TITLE: ASM TK 550CP X 54 HD/NAT 1.9 SULF	REVISION A
STATUS: Released		BH				SHEET 1 OF 1
© SNYDER INDUSTRIES, LLC, 2020				<div>(402) 467-5221 www.snydernef.com</div>	PART NO. 5040000N987	ENG. ID. A018009
ALL DIMENSIONS, DESIGNS, AND INFORMATION ON THIS PRINT MUST BE CONSIDERED PROPRIETARY TO SNYDER INDUSTRIES, LLC, AND MAY NOT BE USED, COPIED, OR DISTRIBUTED WITHOUT WRITTEN PERMISSION OF AN OFFICER (OR HIS AGENT) OF THE FIRM.						

***ALL EXTERNAL PIPING MUST BE INDEPENDENTLY SUPPORTED.**
***ONLY BASE FITTINGS TO BE LEFT INSTALLED AT TIME OF SHIPMENT PER SII PROCEDURE.**
***TANKS ORDERED WITH FOAM INSULATION WILL HAVE AN INCREASED DIAMETER OF 4-6 INCHES.**
***Consult Snyder's Guidelines for Use and Installation prior to delivery.**
 Available on-line at <http://www.snyderindustriestanks.com/Technical>
ALL DIMENSIONS ARE IN INCHES, NOMINAL, & SUBJECT TO CHANGE WITHOUT NOTICE.
ALL DIMENSIONS ON ROTATIONAL MOLDED PARTS ARE SUBJECT TO A ± 3% TOLERANCE.